

EMC Test Equipment Catalog



- Electrostatic Discharge Simulator
- Impulse Noise Simulator
- Fast Transient / Burst Simulator
- Lightning Surge Simulator
- Voltage Dip & Swell Simulator
- Damped Oscillatory Wave Simulator
- Emission Measurement System
- Broadband Sleeve Antenna
- TEM Horn Antenna
- EMC Test Systems for Automotive Electronics

|2|0|2|0|-|2|0|2|1|

www.noiseken.com

Mission statement from NoiseKen

"To challenge the reproduction of electrical noise continuously and aim to be a company that makes customer EMC tests easier."


In 1975, when the term "EMC" began to be used as the phenomenon of malfunctions became a social problem with the spread of computers, we were "a company that manufactures noise testers for reproducing malfunctions of electronic devices." It was founded as.

Since then, in order to contribute to the quality of products that customers make, we have provided EMC testers reproduce (output / measure) electrical noise such as electrostatic discharge phenomenon, high current phenomenon at the time of lightning strike, transient phenomenon in car, contracted EMC test services (contracted test site "Test Lab Funabashi"), and other technical materials such as NoiseKen News (former technical report), test method guidebook. Our brand "NoiseKen" has been adopted by more than 5,000 customers in Japan.


Based on the history and achievements so far, in addition to "continuing to challenge the reproduction of electrical noise" which is the starting point of our founding, we will not only quality, cost and delivery, but also automation and simulation testers / measuring instruments.

"NoiseKen" contributes to EMC and noise countermeasures by aiming to be a "company that makes customer's EMC tests easier" while responding to changes in the way of life, and everyone recognizes its permanent existence.

Variety of Electrical Noises and EMC

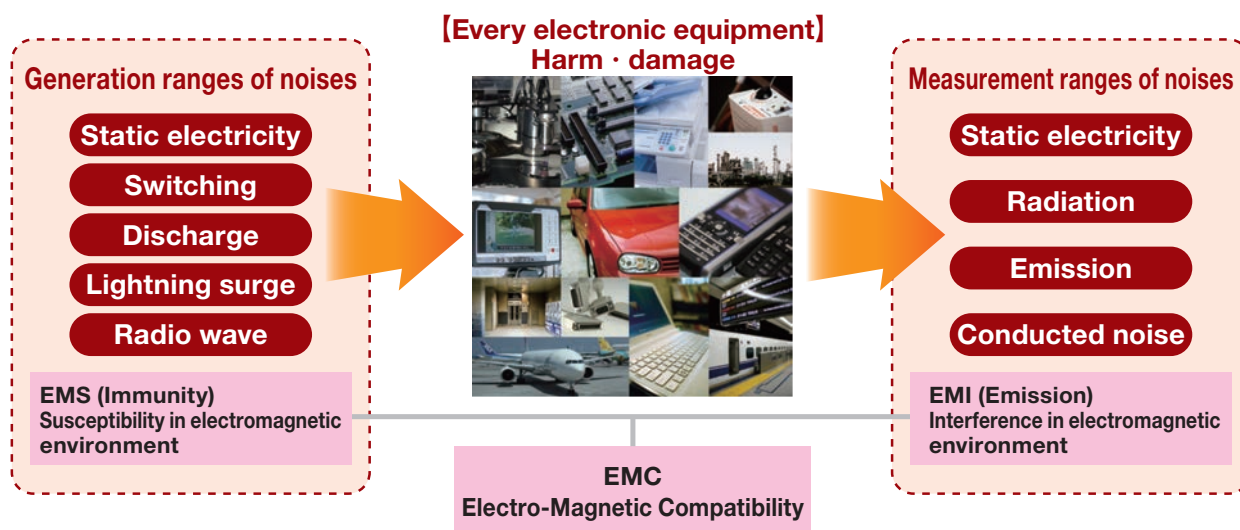

Products & Services of "NoiseKen"

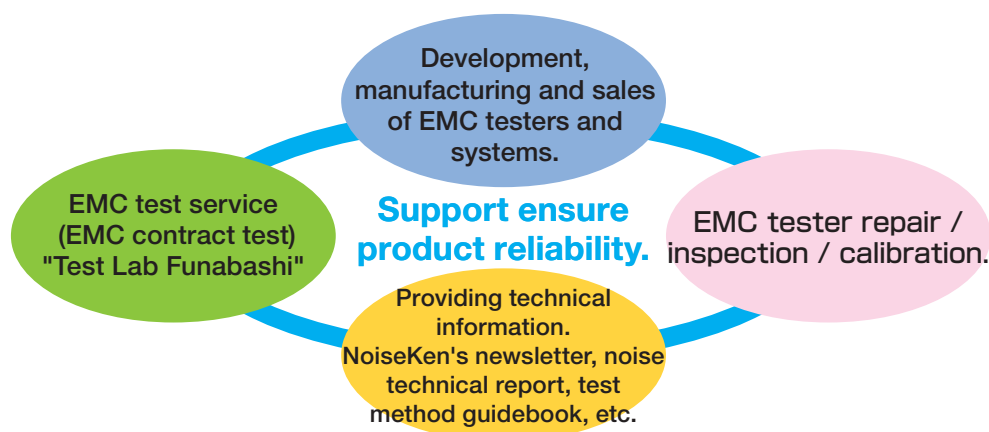

Historical Highlights of Noise Laboratory Co., Ltd.

- 1975 Adachi Noise Laboratory Co., Ltd. establishment / Location of the Head Office : Iguchi, Mitaka-shi, Tokyo
- 1976 Company name was changed into Noise Laboratory Co., Ltd.
- 1984 Head Office was relocated to Noborito, Tama-ku, Kawasaki-shi.
- 1990 Head Office was relocated to Kami-asao, Asao-ku, Kawasaki-shi.
- 1995 Start contract testing and measurement services in Funabashi, Chiba Pref.
Selected as "New business model company" by Kanto Trade & Industry Bureau.
- 1996 Head Office was relocated to Mampukuji, Asao-ku, Kawasaki City,
[Commercialization of "electromagnetic wave interference source exploration device \(ESV system\)" through industry-academia collaboration with Industrial Technology Center of Tochigi prefecture.](#)
- 1997 Equipped an anechoic chamber in Test Laboratory Funabashi
- 2000 Head Office and Kakio Work were relocated to Chiyoda, Sagamihara City.
- 2004 Acquired IEC17025 accreditation.
- 2009 Acquired test site certification in ISO/IEC17025 to Test Laboratory Funabashi by VLAC.
- 2011 China after-sales service office was established.
- 2012 Launched Space-electric/magnetic visualization systems (EPS-02 series) in collaboration with Kanazawa University
- 2015 Launched thin-plate broad band antenna in partnership with Toyota Motor Corp
- 2016 The 32rd Kanagawa Industrial Technology Development Grand Prize incentive-awarded to NKU07M32G Broadband Sleeve Antenna
- 2018 Received "IEC 1906 Award" from IEC (International Electrotechnical Commission)
- 2019 Received the "Excellent paper award" from Environmental Electromagnetic Engineering Study Group, the Institute of Electronics, Information and Communication Engineers.
- 2020 [Commercialization of "TEM horn antenna" through industry-academia collaboration with the National Institute of Information and Communications Technology \(NICT\)](#)
Completion of new building (office building) due to business expansion.

Outline of Noise Laboratory Co., Ltd.

[Company name]	NOISE LABORATORY CO., LTD.
[Location]	Head offices: 1-4-4 Chiyoda, Chuo-ku, Sagamihara City, Kanagawa Pref. 252-0237 Japan TEL : +81-42-712-2051 FAX: +81-042-712-2050
[Establishment]	28th March, 1975
[Board of Directors]	Junichi Fujigaki / Representatives director
[Accounting period]	May
[Dealings banks]	Mizuho bank Machida Branch Bank of Yokohama Sagamihara Ekimae Branch Bank of Mitsubishi UFJ Sagamihara Branch Sumitomo Mitsui Banking Corporation Machida Branch

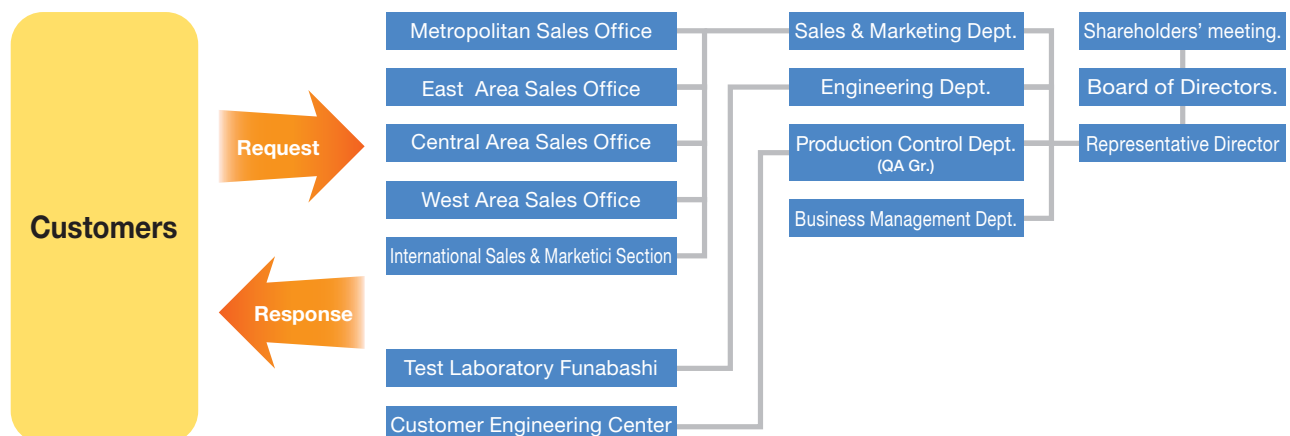


Table of Contents

■ About Noise Laboratory Co., Ltd.	2
■ Table of Contents	4
1 Electrostatic Discharge Simulator	
ESS-S3011A & GT-30RA	5
ESS-B3011A / L1611A & GT-30RA	9
ESS-801 / ESS-801GL (Test environment)	10
IEC61000-4-2 Ed.2 Test Standard Summary	16
ISO 10605 Ed.2 Test Standard Summary	19
2 Noise Impulse Simulator	
INS-S220	24
Testing summary for impulse noise simulator	33
3 Fast Transient / Burst Simulator	
FNS-AX4 A20 / B63	34
IEC61000-4-4 Ed.3 Test Standard Summary	42
4 Lightning Surge Simulator	
LSS-6330A series	46
LSS-F03 series (IEC standard)	51
IEC61000-4-5 Ed.3 Test Standard Summary	58
LSS-720B (JEC Standard)	64
JEC Standard Summary	65
5 Voltage Dip & Swell Simulator	
VDS-2002	66
IEC61000-4-11 Ed.2 Test Standard Summary	68
6 Damped Oscillatory Wave Simulator	
SWCS-931D	71
7 Emission Measurement System	
EPS-02Ev3 Electromagnetic Field Visualization System	72
8 RF Test System	
Broadband Sleeve Antenna	81
TEM Horn Antenna	85
9 EMC Test Systems for Automotive Electronics	
ISO Standard Compliant Automotive Transient Surge Simulator	89
JASO Standard Compliant Automotive Transient Surge Simulator	95
FORD Standard Transient Pulse Generator	96
DC Power Supply Voltage Fluctuation Simulators	100

ESD Simulator

ESS-S3011A & GT-30RA

Free you from the hassle of testing by the pre-check function and the weight reduction of the discharge gun.

EMC test equipment to evaluate the resistibility of electronic equipments when energy charged on a human body or object is discharged to the electronic equipment.

This can be available for evaluating malfunctions or functions declines of electronic equipment against the ESD.

Programmable simulator to ease some complicated tests. The output voltage is up to 30kV and performable IEC61000-4-2 & ISO 10605 Standards compliant tests.



*Probe stand for the discharge gun is option.

- "3 pre-checking function" to make sure the more confirmable test
- "CR constant indicator" to make sure the correct unit attachment
- One-touch exchange of gun head and CR unit realized
- "Ten-key & Rotary knob" to ease the setting.
- "Infra-red Remote Controller" to realize the setting remotely from the generator (Standard attached).
- "Discharge Detecting Function" to realize the air-discharge confirmation.
- "Lightest discharge gun in the market" to lighten the continuous operation (Excluding the cable and connector)
- "White LED Irradiator" to facilitate the visualization of the discharging areas.
- "Control Software" to enable the test result reporting and control with PC.

* The software is scheduled to be downloaded freely from our web-site (The connection cable is necessary in addition).

* C (Capacitor) and R (Resistor) for the discharge gun is one-body unit.

* ISO 10605 compliant test can be realized with the optional parts in addition.

Feature

Achieve more reliable test! Equipped with "3 Pre-check Functions"

The new ESD simulator is equipped with 3 pre-check functions; "high voltage power output check", "insulation failure check", and "discharge relay operation check" on the main body and discharge gun.

You can prevent troubles such as not perform the test properly; if you did not notice the failure of the tester body or the relay inside the discharge gun has reached the end of its life.

PRE CHECK

SET UP

STEP 1

放電ガンガンホルダーにセットし、
〔START〕キーを押下してください。
Please set the ESD GUN to the gunholder,
and press〔START〕key.

- ① Set the discharge gun in the gun holder.
- ② Press the〔START〕key on the tester.

PRE CHECK

SET UP

STEP 2

接触放電チップを〔PRE CHECK〕端子に接触させ、
ガントリガーを引いてください。
Please set the contact discharge tip to
the〔PRE CHECK〕terminal,
and pull the GUN TRIGGER.

- ③ Bring the discharge gun into contact with the pre-check terminal〔PRE CHECK〕and pull the gun trigger.

Pre-check completed!

PRE CHECK	RESULT
[CHECK 1] ...	PASS
[CHECK 2] ...	PASS
[CHECK 3] ...	20

PRE CHECK

RESULT

[CHECK 1] ...	PASS
[CHECK 2] ...	PASS
[CHECK 3] ..	FAILED

Press any key to MAIN MENU.

In case of NG, a "FAILED" message is displayed.

[Check 1] High-voltage power output check: Check the error from the set value.

[Check 2] Insulation defect check: Checks for defective insulation withstand voltage.

When the discharge gun is placed in the attached gun holder, you can check the output of the high-voltage power supply and check for insulation defects.

[Check 3] Discharge relay operation check: Check the relay for wear.

Check the wear of the discharge relay by bringing the discharge gun into contact with the check terminal and discharging.

ESS-S3011A & GT-30RA

“CR constant indicator” to make sure the correct unit attachment.

The constants of the discharge resistance and discharge capacitor, which were previously disassembled and checked, are now displayed on the main unit screen. When the CR unit or discharge cup of the discharge gun is replaced, it is automatically recognized and the type of CR unit is determined. The CR unit and the discharge cup are identified separately, and if the combination complies with the standard, the conforming standard is displayed at the bottom of the main menu.




Whether the gun head corresponds to IEC or ISO ?



What values are the charge capacitor and discharge resistor ?

CR unit [CR]	Discharge cup [CUP]	Compliant standard table
150pF-330Ω	330	IEC 61000-4-2 Ed.2、10605 2nd Ed.
330pF-330Ω	330	ISO 10605 2nd Ed.
150pF-2kΩ	2k	ISO 10605 1st Ed. & 2nd Ed.
330pF-2kΩ	2k	ISO 10605 1st Ed. & 2nd Ed.

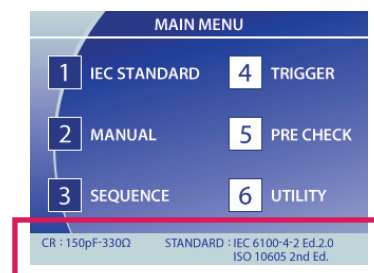

Indicated on the display of the generator

*There are restrictions on the display pattern.


Easy to Check for Discharge Equipped with discharge detection function.

It is possible to check the presence or absence of discharge during an air discharge test, which was difficult until now, by checking the buzzer sound from the tester and the LED display on the top of the discharge gun.


Buzzer sound of the tester



Count up the number of applications

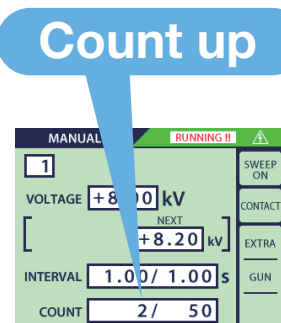

Discharge gun LED color change

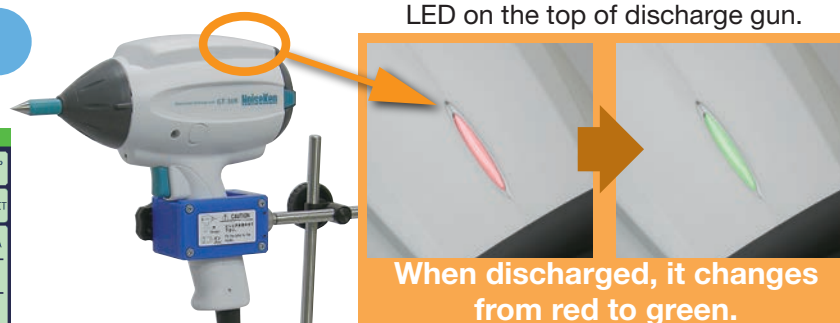

LED on the top of discharge gun.

When discharged, it changes from red to green.

“Infra-red Remote Controller” standard attached to realize the setting remotely from the generator

Since you can operate the tester with the remote control without returning to the tester during the test, the test can proceed smoothly.

Start/Stop

Polarity change

Voltage Up / Down

Air/Contact discharge change

Gun trigger function
Count reset
Sequence change
F key assignment etc.



Most of the operation can be controlled by the remote controller.


ESS-S3011A & GT-30RA

The discharge gun becomes lighter and easier to use.

The discharge gun itself has been reviewed from scratch to achieve weight reduction and the best balance of the center of gravity.

The weight is lighter than previous one and the balance of the center of gravity has been improved, making it extremely easy to hold and reducing the burden on the arm during long-term tests. Please pick it up and try it.

In addition, since it has checked only visually, it is now to check the presence or absence of discharge during aerial discharge, which was difficult to check, with the LED on the top of the discharge gun, making it easy to check. Also, it is a discharge gun with a full range of functions and operations, such as easy replacement of the CR units and discharge cups, which used to take time and effort, and the installation of an "LED light" that brightly illuminates the application.

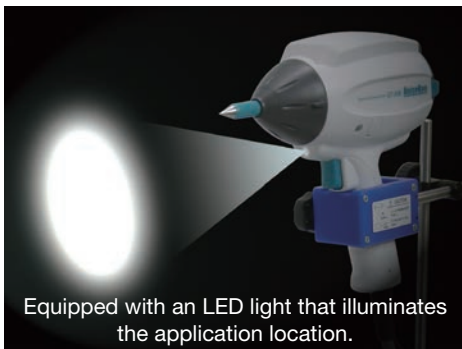

A light and easy-to-hold discharge gun!
Improved balance of the center of gravity and weight reduction of over 20%.



Light and soft!
High voltage cable and ground return cable.



One-touch replacement of CR unit.



Easy to replace the discharge cup.

ISO 10605 standard compliant discharge gun package available

By adding the optional discharge cup and CR units, it performs tests that comply with the ISO 10605 standard.

Since it is easily replaced the discharge cups and CR units, various CR constants can be tested with a single discharge gun.

**Options for ISO 10605 Standard compliant test**

Model	Name
12-00009A	Discharge tip (GT-30R series Spherical 30 mm)
03-00072A	Gun head to GT-30R series for constant 2 kΩ test
06-00074B	CR unit (150 pF - 2 kΩ) to GT-30R series
06-00076B	CR unit (330 pF - 2 kΩ) to GT-30R series
06-00075B	CR unit (330 pF - 330 Ω) to GT-30R series



Gun head
for constant 2 kΩ test



CR unit




Discharge tip
(Spherical 30 mm)

ESS-S3011A & GT-30RA

High visibility LCD panel and operatability

Reviewed the past operatability so that more easy and optimal operation can be realized.

In " 1 IEC STANDARD" in MAIN MENU, since the test levels are preset, the test parameters can be set easily only with selection of the test level.
In " 2 MANUAL", voltage and number of times of the test can be selected and also the set conditions can be recorded. Sweeping discharges can be set as well. In " 3 SEQUENCE", the set conditions in MANUAL can be recalled for combining them so as to realize the arbitrary sequential tests. In addition, varied functions like setting for gun trigger, automated ESD eliminator, etc. are equipped.

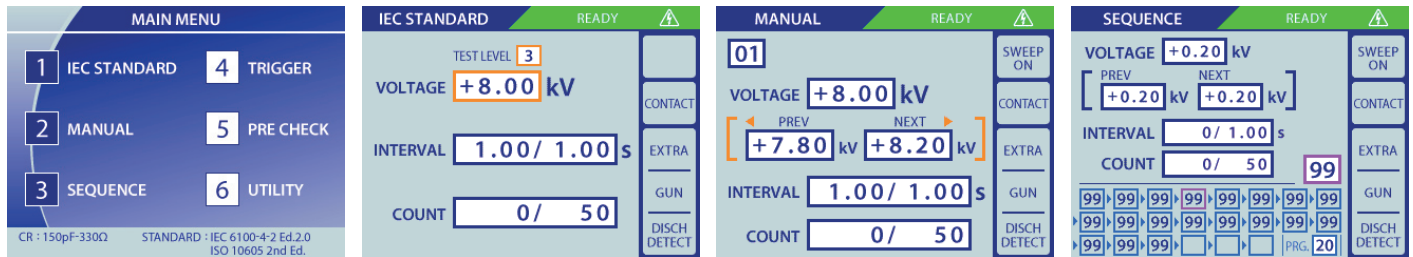

Specification

Parameter	Specification
Polarity	Positive / Negative
Output voltage	0.20 kV ~ 30.0 kV \pm 5% (30.5 kV max) ~ 10.0 kV : 0.01 kV step ~ 30.0 kV : 0.1 kV step
Repetition cycle	0.05s ~ 600s \pm 10% / Manual Set step : 0.01s (0.05 ~ 9.99s), 0.10s (10.0 ~ 600.0s)
No. of time of discharge	1 ~ 60,000 times, Preset 1 time step or continuous preset
Discharge mode	Contact discharge / Air discharge
Radiation level mode	NORMAL mode / EXTRA mode
Trigger mode	Gun trigger / Main trigger / External trigger
Operation panel	Color LCD / Push-buttons (Partially lighting)
Gun holder	Standard attached (to hold the discharge gun Model GT-30RA)
Radiation mode select switch	Extra / Normal switching function built-in
Discharge detection	Discharge detection function in air-discharge equipped
Pre-checking function	Following 3 steps function equipped (by user operation. Not the calibration but just checking) STEP1 : High voltage output checking STEP2 : Withstanding voltage checking STEP3 : Discharge relay operation checking
CR & Gun head checking	CR constant and gun head recognizable (with an indicator to prevent the wrong combination)
"IEC STANDARD" test mode	Contact discharge mode : 2.0 kV, 4.0 kV, 6.0 kV and 8.0 kV step Air discharge mode : 2.0 kV, 4.0 kV, 8.0 kV and 15.0 kV step
"MANUAL" test mode	Contact / Air discharge mode, Arbitrary setting during 0.2 kV ~ 30.0 kV Sweeping function built-in, Recordable up to 99 units
"SEQUENCE" test mode	Enables to operate units set in MANUAL mode continuously. Max. 22 steps / 1 program and the programs recordable up to 20.
Warning lamp	Lighting at voltage output from the generator. Blinking at electro-static discharging
Charge capacitor / resistor	150 pF \pm 10%, 330 Ω \pm 10%(Built-in CR unit for discharge gun GT-30RA)
Charge resistor in generator	10 M Ω (Totally 53 Ω in combination with 43 M Ω in discharge gun)*
AUX connector	D-SUB 15 pins female connector (for connecting to patrolight, automated ESD eliminator, external interlock input, external trigger input terminal)
Optical communication	Optical connector (serial interface) for connecting to PC connector
Power supply / consumption	AC100 V ~ AC240 V 50 Hz / 60 Hz \pm 10% 75VA
Dimensions	Generator : (W)392 mm \times (H)312 mm \times (D)295.3 mm (gun holder included) Discharge gun : (W)83.3 mm \times (H)217.2 mm \times (D)229.3 mm
Weight	Generator : approx. 7.5 kg Discharge gun : approx. 800 g (cable and connector excluded)

* The constant depends on combination with CR unit for the discharge gun

■ Breakdown of GT-30RA discharge gun: Discharge gun (with discharge cup 330 Ω test), CR unit 06-00073B (150 pF - 330 Ω), discharge tips (conical / round)

ESD Simulator

ESS-B3011A & GT-30RA

Cost-oriented Basic models

Cost-oriented basic model ESD Simulator the light Weight discharge gun attachable.

The output voltage can be selected max. 30 kV.

And compliant to both EN / IEC 61000-4-2 Standard and ISO 10605 Standard.

- “Pre-checking function” taking the confirmable test into the account
- “CR constant checking function” (No indicator) to make the correct unit attachment sure”
- “Discharge Detecting Function” to realize the air-discharge confirmation.
- “Lightest Discharge Gun in the market” to lighten the continual operation”
- “White LED Irradiator” to facilitate the visualization of the discharging area.
- One-touch exchange of gun head and CR unit realized

* ISO 10605 compliant test performable with addition of the gun head and CR units (only with ESS-B3011A)



*Probe stand for the discharge gun is option.


Specification

Parameter	Specification
Modell	ESS-B3011A
Output voltage	0.20 kV ~ 30.0 kV \pm 5% (30.5 kV max)
Polarity	Positive / Negative
Repetition cycle	0.05s ~ 9.99s \pm 10%, 0.01s step / Manual
No. of time of discharge	1 ~ 999 times, Preset 1 time step or continuous preset
Discharge mode	Contact discharge / Air discharge
Trigger mode	Gun trigger / Main trigger
Operation panel	Indicator : 5 \times 7 Dot matrix LED / Operation : Push buttons (Partially lighting)
Radiation mode select switch	Extra / Normal switching function built-in
Discharge detection	Discharge detection function in air-discharge equipped.
Pre-checking function	High voltage output checking function (by user operation. Not the calibration but just checking)
CR & Gun head checking	CR constant and gun head recognizable (to prevent the wrong combination without indicator)
IEC LEVEL	Contact discharge mode : 2.0 kV, 4.0 kV, 6.0 kV and 8.0 kV step
Switching function	Air discharge mode : 2.0 kV, 4.0 kV, 8.0 kV and 15.0 kV step
Warning lamp	Lighting at voltage output from the generator. Blinking at electro-static discharging
Charge capacitor / resistor	150 pF \pm 10%, 330 Ω \pm 10% (Built-in CR unit for discharge gun GT-30RA)
Charge resistor in generator	10 M Ω (Totally 53 Ω in combination with 43 M Ω in discharge gun)*
Power supply / consumption	AC 100 V ~ AC 240 V \pm 10% 50 Hz / 60 Hz 62 VA
Dimensions	Generator : (W)270 mm \times (H)263 mm \times (D)200 mm Discharge gun : (W)83.3 mm \times (H)217.2 mm \times (D)229.3 mm
Weight	Generator : Approx. 4.8 kg Discharge gun : Approx. 800 g (excluding cable and connector)

* Remote control function not built-in.

* The constant depends on combination with CR unit for the discharge gun

Discharge output waveform (IEC Standard)

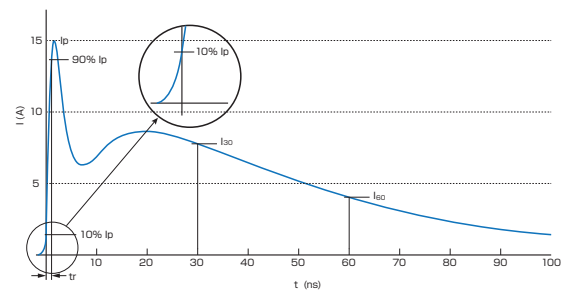

Test environment (Table-top type / Floor-standing type)

ESS-801 / 801GL

Feature

ESD test environment in conformance with EN/IEC61000-4-2 Standard.

Two types for EUT are available, table-top type and floor-standing type so that the environments can support the tests along EUT figures. Since the table is made of wood, influence to the test result should be small (quantifiable test result can be expected since the discharge can be realized in state high frequency electromagnetic field is less lost) and the high reproducibility can be expected and realized. Also, versatilely utilized for another tests like impulse noise immunity test, etc.

- ESD test environments in conformance with EN/IEC61000-4-2 standard
- High reproducible tests can be performed
- Can be versatilely utilized for another tests

Specification

ESS-801 (Table-top type)


Item	Model	Dimensions	Q'ty
Test table	03-00039A	(W) 1600 × (H)800 × (D) 800 mm	1 set
Vertical coupling plate	03-00005A	(W) 500 × (H)500 × (t) 1.5 mm	1 set
Ground plane	03-00007A	(W) 1800 × (D)1000 × (t) 1.5 mm	3 pcs.
Insulating sheet	03-00004A	(W) 1450 × (D)650 × (t) 0.5 mm	1 pc.
Discharge resistance cable	05-00054B	2 m cable equipped with 470 kΩ × 2 pcs.	2 pcs.
Horizontal coupling plate	03-00020A	(W) 1600 × (D)800 × (t) 1.5 mm	1 pc.

ESS-801GL (Floor-standing type)

Item	Model	Dimensions	Q'ty
Insulating support	03-00024A	(W) 1200 × (H)1200 × (t) 100mm	1 pc.
Floor-standing vertical coupling plate	03-00034A	(W) 540 × (H)1540 × (D) 500mm	1 pc.
Ground plane	03-00007A	(W) 1800 × (H)1000 × (t) 1.5mm	3 pcs.
Discharge resistance cable	05-00054B	2 m cable equipped with 470 kΩ × 2 pcs	1 pc.




Test setup example with ESS-801
* Contents in the set referred to following specification

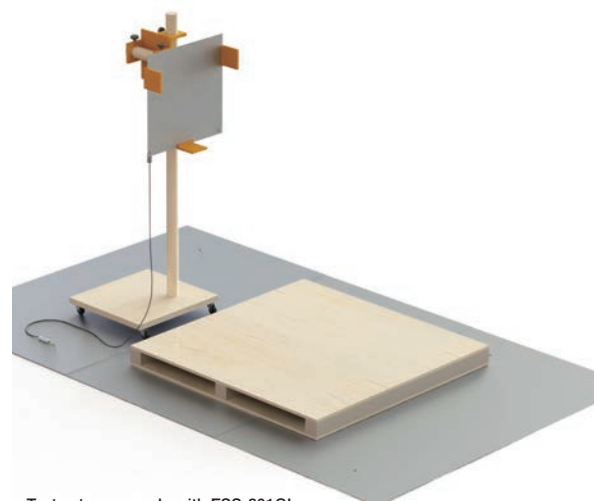

Test setup example with ESS-801GL
* Contents in the set referred to following specification

Option

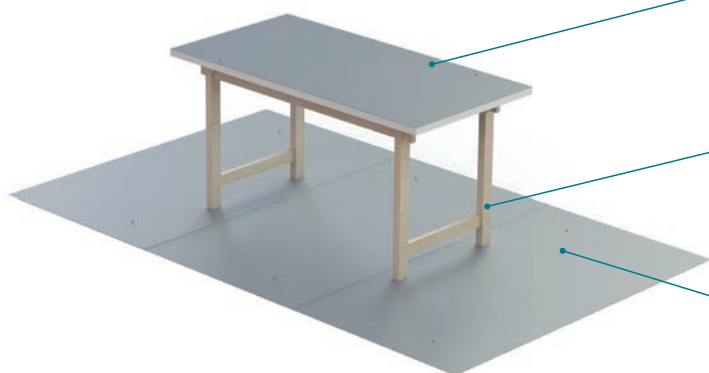

Horizontal Coupling Plate (HCP) MODEL : 03-00020A

Metal plate to be placed onto the table in case of the testing to table top devices.
W1600 × D800 × t1.5mm × 1 pc.(Made of aluminum)

Test Table MODEL : 03-00039A

Wooden table to be used for the test to devices under test (DUT).
W1600 × H800 × D800 mm

Ground Reference Plane (GRP) MODEL : 03-00007A

Ground plane to be placed just under the wooden table.
W1800 × D1000 × t1.5 mm × 3 pcs. in 1 set (Made of aluminum)

Discharge resistance cable MODEL : 05-00054B




Cable to be used for eliminating the ESD on DUT and connect between HCP and GRP
470 kΩ × 2 pcs./1 set.

Insulating support MODEL : 03-00024A



When doing the electrostatic discharge test to floor-standing equipment, to be used for floating the equipment 10cm higher than the ground reference plane.
Size : W 1200 × D 1200 × H 100 mm
Material : Wooden
Withstanding loads : 500 kg

Option

Cubic Insulating Block100 MODEL : 03-00029A

Used for floating EUT 10cm upper than the ground plane in case of testing to floor-standing EUT
Size : W100 × D100 × H100 mm
Material : Wood
Withstanding loads: 500 kg

ESD Elimination Brush MODEL : 05-00125A

Brush to eliminate the electrification on EUT / DUT before starting the test.

Automated ESD Eliminator MODEL : 01-00013B


Enable to eliminate electric charge which has been charged to EUT automatically with connection to ESS-S3011A

● Available model : ESS-S3011A

Conversion Adaptor for Probe Stand MODEL : 03-00074A

Adaptor for connecting between probe stand PS-806 or 03-00022B and discharge gun GT-30R series.

● Available discharge gun : GT-30R series

Probe Stand MODEL : 03-00108A

A probe stand used to fix the discharge gun for ESD Simulator. (Excluded from IEC standard) Because of the articulated type, the discharge gun fixes in any direction.

Item	Specification
Dimensions	(H)380 mm, Pedestal diameter 160 mm
Weight	approx. 4.1 kg
Range of movement	Vertical: 150 mm, Swing angle: 130°


● Available discharge gun : GT-30R series

**Free Arm Gun Stand MODEL : 03-00022B**

Enable to move discharge gun vertically and horizontally to arbitrary desirable discharging point. (Out of ISO Standard)

● Corresponding discharge gun : GT-30R series

* Conversion adaptor model 03-00074A is necessary in addition for the attachment to GT-30R series

Insulating Support MODEL : 03-00066A

Sheet to be laid out in between DUT and GRP for the test to automotive electronics devices.
W1450 × D650 × t2 mm




Aluminum Plate for Test MODEL : 03-00053A

Plate to be laid out under tires for the vehicle test
W500 × D500 × t1.5 mm

Insulating Block MODEL : 03-00054A


Blocks to float (isolate) wirings of DUT from GRP.
W300 × D300 × H50 mm, 5 pcs. in 1 set

Conductive Mat (for ISO Standard) MODEL : 03-00055A

Mat to be laid out in between DUT and GRP for the ESD susceptibility test in the packaging and handling.
Surface resistance $10^7 \times 10^9 \Omega$
W1000 × D500 × t2 mm

Ground Cable (for ISO Standard) MODEL : 05-00104A

Cable to be used for grounding connection required in ISO 10605 (2001). L2000 × W50 mm
* Not required in ISO 10605 Ed.2 (2008)

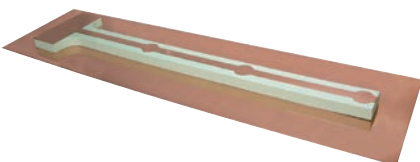Coupling Plate for ISO 10605 Annex F MODEL : 03-00065A

Coupling plate used for the optional test in ISO 10605 Ed.2 (2008). It consists of a coupling plate (made of copper) and an insulation block.
* Ground reference plane is not included.

Option

CR Unit M



CR unit for ESD gun GT-30R series

- Available discharge gun : GT-30R series

* Please contact us when the other CR constant is required than the right description.

* The unit size depends on the capacitor constant.

Model	CR constant	Model	CR constant
06-00073B	150 pF - 330 Ω	06-00081B	150 pF - 150 Ω
06-00074B	150 pF - 2 kΩ	06-00082B	500 pF - 500 Ω
06-00075B	330 pF - 330 Ω	06-00083B	500 pF - 5 kΩ
06-00076B	330 pF - 2 kΩ	06-00084B	250 pF - 100 Ω
06-00077B	500 pF - 0 Ω	06-00085B	200 pF - 100 Ω
06-00078B	150 pF - 500 Ω	06-00086B	250 pF - 0 Ω
06-00079B	100 pF - 1.5 kΩ		
06-00080B	200 pF - 0 Ω		



For ISO 10605 compliant test

- GT-30R3302KA package contents

GT-30R series	gun body
03-00071A	gun head
03-00072A	gun head
06-00073B	150 pF - 330 Ω CR unit
06-00074B	150 pF - 2 kΩ CR unit
06-00075B	330 pF - 330 Ω CR unit
06-00076B	330 pF - 2 kΩ CR unit
12-00007A	conical tip
12-00008A	round tip
12-00009A	spherical tip

Energy storage capacitor / Discharge resistor values	1st discharge peak current	t ₁ Current	t ₂ Current
150 pF / 330 Ω ①	3.75 A / kV ± 10%	2 A / kV ± 30% (t ₁ = 30 ns)	1 A / kV ± 30% (t ₂ = 60 ns)
330 pF / 330 Ω ②	3.75 A / kV ± 10%	2 A / kV ± 30% (t ₁ = 65 ns)	1 A / kV ± 30% (t ₂ = 130 ns)

Energy storage capacitor / Discharge resistor values	1st discharge peak current	t ₁ Current	t ₂ Current
150 pF / 2 kΩ ③	3.75 A / kV +30% -0%	0.275 A / kV ± 30% (t ₁ = 180 ns)	0.15 A / kV ± 50% (t ₂ = 360 ns)
330 pF / 2 kΩ ④	3.75 A / kV + 30%-0%	0.275 A / kV ± 30% (t ₁ = 400 ns)	0.15 A / kV ± 50% (t ₂ = 800 ns)

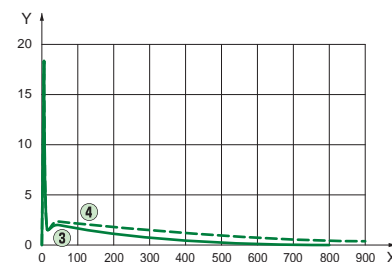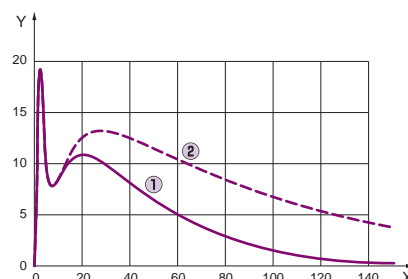

Gun Head MODEL : 03-00071A / 03-00072A



Gun head to be changed according to Standard compliant test. 2 kinds for the test with 330 Ω (03-00071A) and 2 kΩ (03-00072) are lined up.

- Available discharge gun : GT-30R series

Fast Rise Time Adaptor MODEL : 03-00073A



Fast Rise Time Adaptor MODEL : 03-00073A
Realize faster rise time of the discharge current than IEC 61000-4-2 standard value (0.6 ~ 1.0 ns) around 0.2 × 0.3 ns with attachment to the discharge gun.

- Available discharge gun : GT-30R series

Discharge Tip MODEL : 12-00007A / 8A / 9A



Discharge tips on the gun.
Conical (12-00007A) and Round (12-00008A) are standard equipped with GT-30R series.
The all 3 tips are standard equipped with GT-30R series.

- Available discharge gun : GT-30R series

Impulsive Electric Field Adaptor MODEL : 03-00068A



Adaptor for simulating static induction as one of noise inductive mode with attachment to the discharge gun (Not standardized in IEC)

- Available discharge gun : GT-30R series

Option

Impulsive Magnetic Field Adaptor MODEL : 03-00069A

Adaptor for simulating electromagnetic induction as one of noise inductive mode with attachment to the discharge gun (Not standardized in IEC)

- Available discharge gun : GT-30R series

Magnetic Field Adapter MODEL : 03-00070A

Magnetic field adapter for Ford standard. Connected to GT-30R series discharge gun, it generates transient magnetic fields.

- Available discharge gun : GT-30R series

Item	Specification
Loop coil diameter	155 mm
Dimensions	168 mm (loop outer diameter) 300 mm (length) 12.7 mm (thickness of the loop)

Extension cable for GT-30R MODEL : 05-00047B

Extension cable in connection between ESD simulator main unit and its discharge gun. The length is 3 m
* not compliant with the IEC standard

- Available discharge gun : GT-30R series

Gun Holder MODEL : 03-00075A

Holder for discharge gun during the test. Also, can be the pre-checking fixture in combination between ESS-S3011A and GT-30R series.

- Available discharge gun : GT-30R series

Specialized Case for Discharge Gun MODEL : 09-00006A

Specialized Case for putting the discharge gun, CR units and the other related fixtures and carrying them out.

- Available discharge gun : GT-30R series

Warning Lamp MODEL : 11-00014B

Caution is alerted with its blinking while the HV circuit is on.

- Available model : ESS-S3011A

* The connection is done with DSUB connector.

AUX Connector Junction Box MODEL : 05-00052A

Enable to connect warning lamp, automated ESD eliminator and external trigger simultaneously

- Available model : ESS-S3011A

Optical USB Module MODEL : 07-00022A

Optical conversion adaptor Used for remote control with PC. 5 m of optical fiber cable with USB interface attached.

- Available model : ESS-S3011A

Optical RS232 Module MODEL : 07-00017A

Optical conversion adaptor used for remote control with PC. 5 m of optical fiber cable with RS232 interface attached.

- Available model : ESS-S3011A

Option


Faraday cage MODEL : FC-200



Faraday cage which is defined in IIEC61000-4-2 Standard and ISO 10605 Ed.2 Standard to verify the discharge current waveform. Easy to move with casters equipped to the bottom.

Item	Specification
Power supply	AC100 V 50 Hz / 60 Hz 3 P inlet Equipped with over-current protective breaker
Opening Dimensions on door	(W) 410 mm × (H) 618 mm
Dimensions / Weight	(W) 670 mm × (H) 1612 mm × (D) 1509 mm Approx. 65 kg, 3p outlet × 2 15 A MAX

Load Resistor Mounting Board MODEL : 03-00052B



The board to fix the load resistor (MODEL NO. 06-00067A ESD current target) for measuring the discharge current waveform defined in IEC61000-4-2 Standard and ISO 10605 Ed.2 Standard
Dimensions : 1.2 m × 1.2 m

Coaxial Cable MODEL : 02-00132A



High frequency responsible cable to connect ESD target And oscilloscope
BNC-SMA connector (02-00133A) is also available as an option

GND Cable Positioner MODEL : 03-00060A



Stand to pull and fix the ground cable of discharge gun 0.5 m backward at the middle of the cable when calibrating the ESD current.


ESD Current Target Calibration Set MODEL : 06-00068A

Set to calibrate the ESD target (06-00067A) in conformance with IEC61000-4-2 Ed.2.0 (2008).



Adaptor (06-00068A)

A photo of 06-00067A ESD target and 06-00068A adaptor connected faced to face

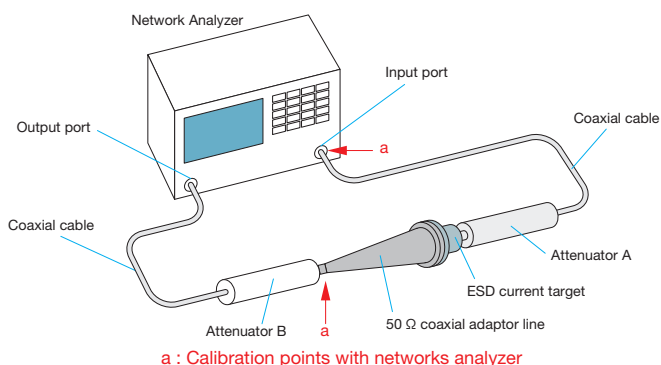

Load Resistor Mounting Board MODEL : 03-00027A



The board to fix the load resistor (MODEL NO. 06-00067A ESD current target) for measuring the discharge current waveform defined in IEC61000-4-2 Standard and ISO 10605 Ed.2 Standard. (not conforming to the standard strictly but simply)
Dimensions : 0.6 m × 0.6 m

ESD Current Target MODEL : 06-00067A



Load resistor to measure, verify and calibrate ESD current waveform defined in IEC61000-4-2 Standard and ISO 10605 Ed.2 Standard

Parameter	Specification
300 kHz ~ 1 GHz	±0.5 dB
1G Hz ~ 4 GHz	±1.2 dB
Maximum applied voltage	15 kV
Conversion ratio	2 V / 1 A (50 Ω termination)
Weight	Approx. 400 g

Discharge Gun Mount MODEL : 03-00061B




Fixture to load and fix the discharge gun to be Faraday cage (FC-200) or load resistor mounting board (03-00052B)

Attenuator MODEL : 00-00010A / 00-00011A



Attenuator to protect measurement equipment for ESD current waveform.

00-00010A : Attenuation ratio 6 dB / SMA connector
00-00011A : Attenuation ratio 20 dB / N connector

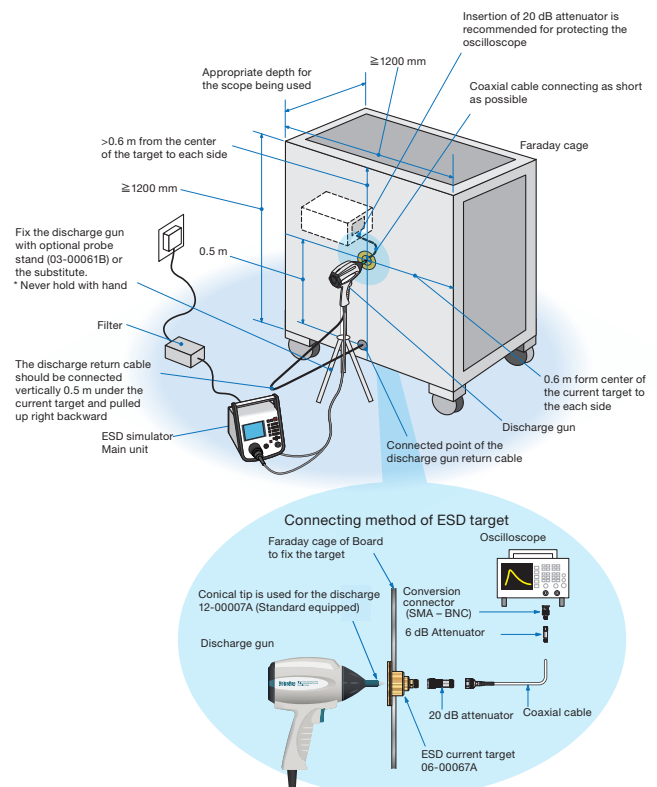


Micro-gap Discharge Tip MODEL : 12-00010A

Enabling a more stringent evaluation for the real world ESD immunity

Connected to the NoiseKen ESD gun, this tip allows for a waveform with higher peak amplitude and a faster rise time. It is a common view that ESD immunity testing is the most challenging and passing the standard test does not always assure real world immunity. This tip is helpful for more extensive testing against non-standardized field events

- Events you can simulate are
- Loose screws
- Poor insulation coating
- Poor electrical connection between components and others which cause secondary discharges within a very close distance

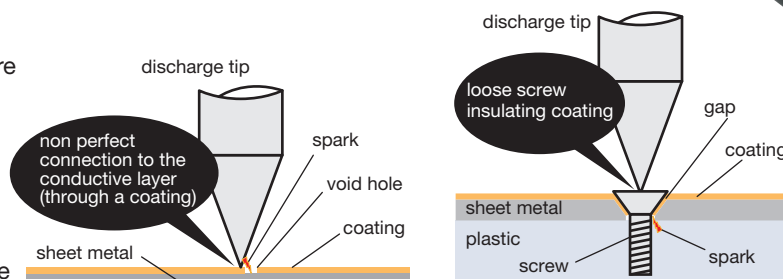





dedicated cup
Model : 03-00103A



enlarged photo
of the micro-gap

Simulated field events

Output waveform (reference)

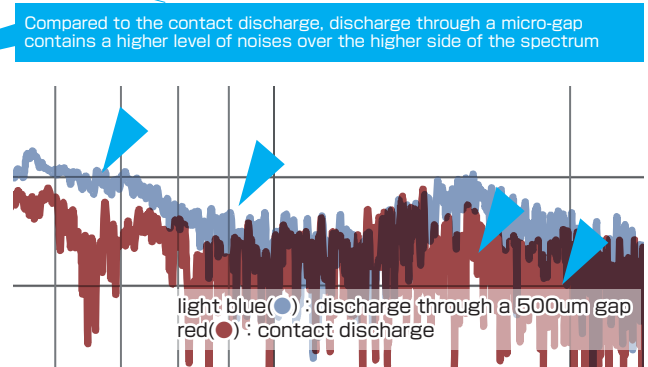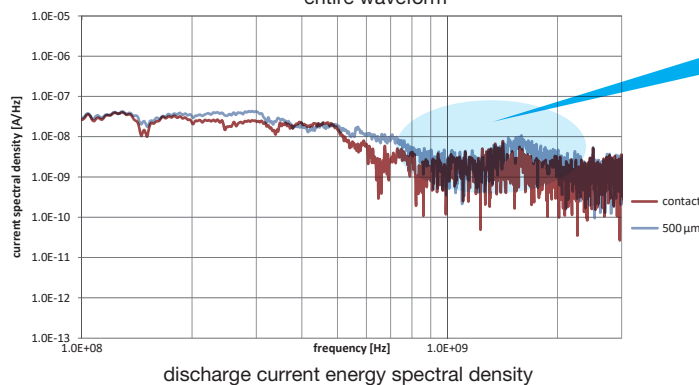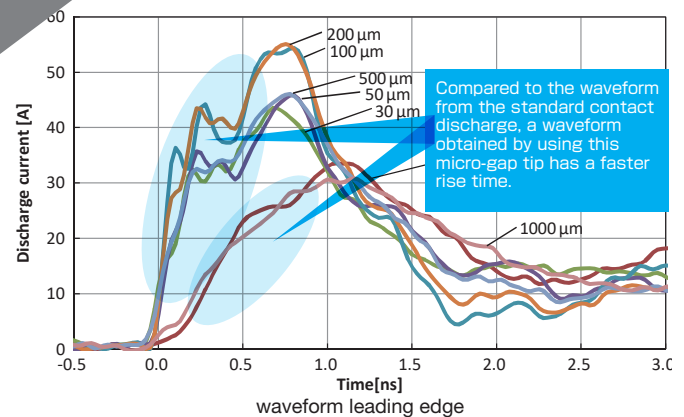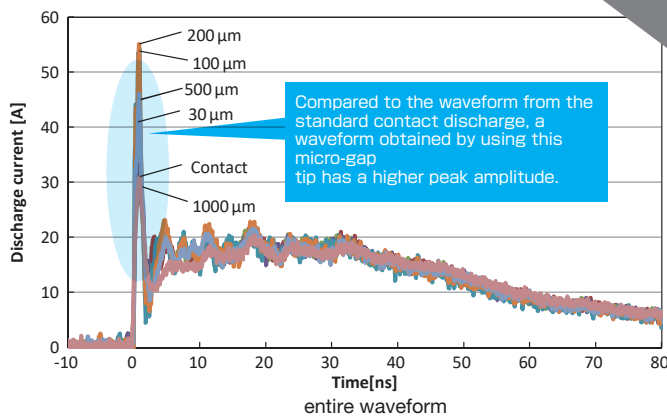

Testing with energy rich pulses for the GHz region

Compatible discharge gun

TC-815S, 815R, 815ISO, 815-330, 815-2K, 815S-330, GT-30Rseries (the dedicated cup 03-00103A required)

*This product cannot be used for the air discharge testing

IEC61000-4-2 Ed.2 Test Standard

1. General

The international immunity test standard which applies to electronic equipment against ESD generated directly from a human body or near metal objects in condition chemical fibers carpets or clothings are used in low humidity relatively. This standard assumes cases an charged human body discharges to electronic equipment and testing with the circuit to simulate current waveform generated in such conditions

2. Test Level

Test level range for the ESD

The levels as below.

Level	Test voltage (contact discharge)	Test voltage (air discharge)
1	2 kV	2 kV
2	4 kV	4 kV
3	6 kV	8 kV
4	8 kV	15 kV
X	Special	Special


* x can be any level determined by consent between the EUT manufacturer and the simulator supplier

3. Test Generator and Waveform Verification

Generator specification

The generator must satisfy following specification.

Energy accumulation capacity	150 pF (typical)
Discharge resistance	330 Ω (typical)
Output voltage	8 kV / Contact discharge, 15 kV / Air discharge
Tolerance of output voltage	$\pm 5\%$
Polarity of output voltage	Positive and negative (Switching available)
Hold time	≥ 5 sec.
Discharge mode of operation	Single discharges (Discharge interval ≥ 1 sec)
Waveform of discharge current	See right figure

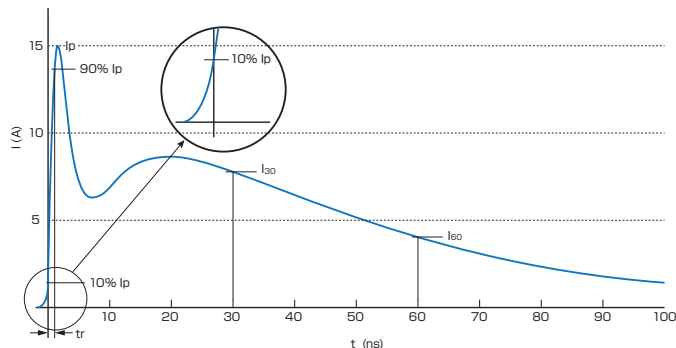


Discharge current waveform and its characteristics

Generator characteristics

The characteristics in following table must be verified in order to compare the tests results even among different generators

Level	Indicated voltage	1 st peak current of discharge ($\pm 15\%$) I_p	Rise time ($\pm 25\%$)	Current ($\pm 30\%$) at 30 ns	Current ($\pm 30\%$) at 60 ns
1	2 kV	7.5 A	0.8 ns	4 A	2 A
2	4 kV	15 A	0.8 ns	8 A	4 A
3	6 kV	22.5 A	0.8 ns	12 A	6 A
4	8 kV	30 A	0.8 ns	16 A	8 A

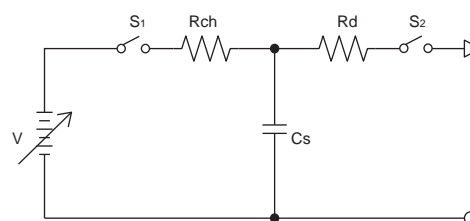

Capacitance C_s : 150 pF
Discharge resistance R_d : 330 Ω

Simplified diagram of the ESD generator


IEC61000-4-2 Ed.2 Test Standard

Waveform verification of ESD Generator

Measure the waveform with an oscilloscope whose band width is 2 GHz or more upon use of Faraday cage and the current target.

Attach the discharge electrode directly to the current target and operate the generator with the contact discharge mode.

* It is recommended that insertion of approx. 20 dB attenuator for protecting the measurement equipment although it is not specified in IEC Standard.

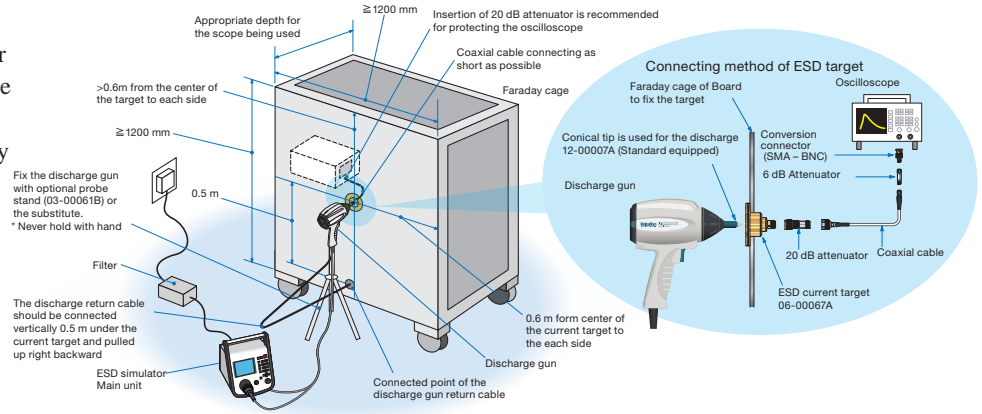


4. Test setup

Example of test set-up for table-top equipment

The direct discharge test is electrostatic direct discharge to EUT and examine the influence.

Put a wooden table whose height is 0.8 m on the ground plane and place horizontal coupling plate (HCP 1.6 m × 0.8 m). Connect the HCP with resistor 470 kΩ × 2 to the ground plane and lay a insulation sheet between the HCP and the EUT.

The indirect discharge test is electrostatic discharge to the HCP and vertical coupling plate (VCP 0.5 m × 0.5 m) and examine the influence of EUT. Connect the VCP with resistor 470 kΩ × 2 to the ground plane as well.

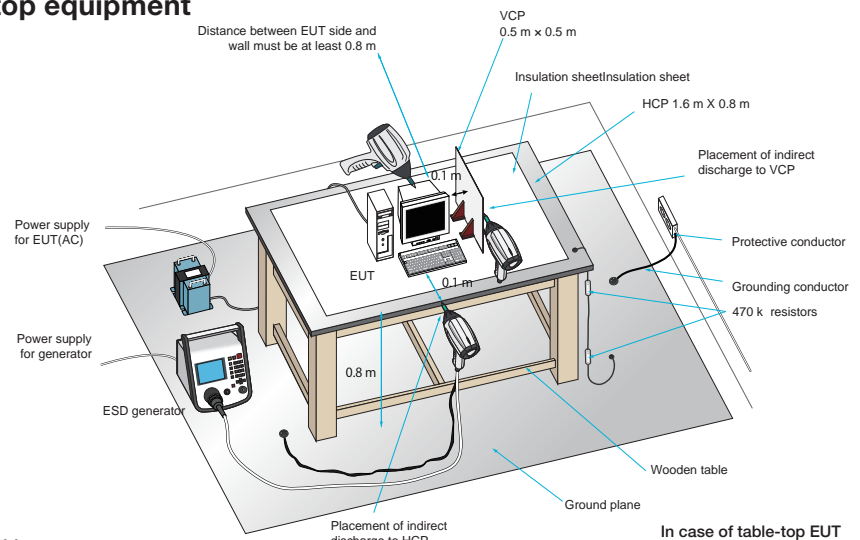


* The isolation transformer for EUT is not specified in IEC Standard.

Example of test set-up for floor-standing equipment

Put an insulation pallet whose height is 0.1 m onto the ground plane and place EUT on the pallet for the direct discharge test.

The indirect discharge test is electrostatic discharge to the VCP and examine the influence of EUT. Connect the VCP with resistor 470 kΩ × 2 to the ground plane as well.

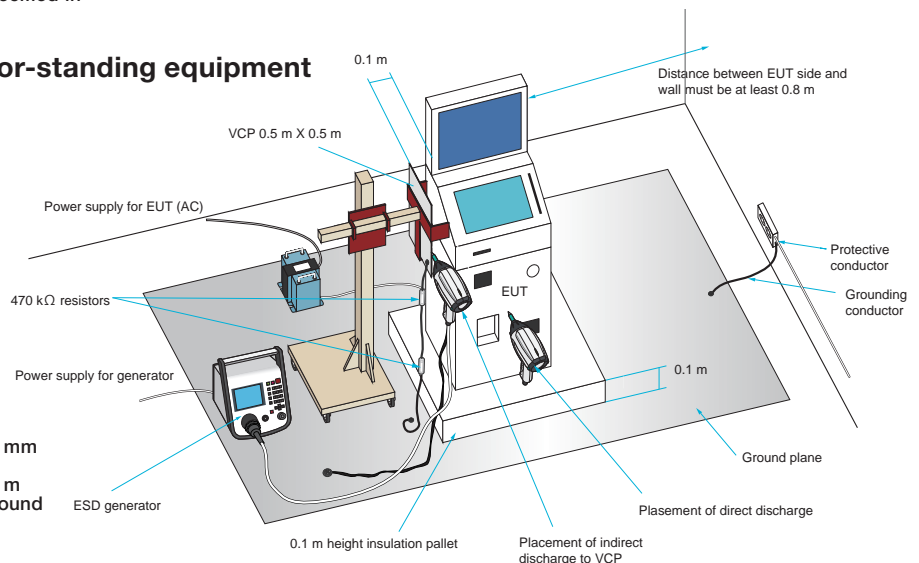

* Float cables from the ground plane with 0.5 mm thickness insulation sheet.

* Keep GND cable of the discharge gun ≥ 0.2 m from any conductive parts other than the ground plane

* The isolation transformer for EUT is not specified in IEC Standard.

IEC61000-4-2 Test Standard

5. Test Procedure

■ Climatic and Other Environmental Conditions

It is necessary to leave equipment which are brought in from different climatic conditions fully before performing the test. Also, in order to stabilize the discharging condition certainly, it is necessary to fix the climatic conditions in the test room.

Fulfillment of the conditions listed in following table must be required to perform testing in conformance with IEC61000-4-2.

Ambient temperature	15°C to 35°C
Relative humidity	30% to 60%
Atmospheric pressure	86 kPa (860 mbar) to 106 kPa (1060 mbar)
Electromagnetic conditions	Level not to affect the test result

■ Test Procedure

Direct discharge test : Contact discharge (at 1 second interval) and air discharge

Indirect discharge test : Discharge to VCP and HCP

At least 10 single discharges shall be applied at 1 second or longer interval in both positive and negative polarities.

* A preliminary test which discharges 20 times or more per second may be done in order to select the points to which single discharges should be applied.

6. Evaluation of Test Results and Test Report

The tests results are classified into following 4 patterns according to specifications of EUT and operating conditions.

- 1) Normal operation within the tolerance of the specification
- 2) Temporary degradation or loss in the operation or the function which is able to be recovered by a self-recovery function
- 3) Temporary degradation or loss in the operation or the function which needs to be recovered by user intervention or reset in the system.
- 4) Damage of the system (parts) or software, and unrecoverable degradation in the function due to loss of the data.

Generally, as far as the EUT is immune to the ESD during testing and it satisfies the functional requirements according to the product specification after testing, the test result can be perceived as "Pass"

The test report shall contain the test conditions and the result.

Notes: This test procedure and test set-up are extracted from IEC 61000-4-2 (2009) and JIS C 61000-4-2 standardised.2.0 (2005) Standard for applying to our products.
Please go through the Standards if the more details are required.

ISO 10605 Ed. Test Standard

1. General

Electrostatic discharges which are generated both in vehicles and while we get on and off there can be factors to cause malfunction of the electrical devices and components. Nowadays, more attention has been paid, as vehicles install more and more electronic devices and components. This Standard provides that static electricity is discharged to the electronic devices or equipment from the charged human body and tests are simulated by electrical circuit to reproduce the electric current waveform at the discharge.

In addition to procedures for the immunity tests and evaluations in state that the electronic devices or equipment work while the vehicle is driving, also, the Standard provides tests procedures to evaluate the immunity of the each module against simulated human discharges during the assembly process or in servicing.

2. Test level

The following tests levels are reference. The categories are classified according to functional importance of the electronics devices/components.

Component test – Example severity levels for direct contact discharge and direct air discharge (Function performance status)

Test severity level	Direct contact discharge			Direct air discharge.		
	Category 1	Category 2	Category 3	Category 1	Category 2	Category 3
Level 4	± 8 kV	± 8 kV	± 15 kV	± 15 kV	± 15 kV	± 25 kV
Level 3	± 6 kV	± 8 kV	± 8 kV	± 8 kV	± 8 kV	± 15 kV
Level 2	± 4 kV	± 4 kV	± 6 kV	± 4 kV	± 6 kV	± 8 kV
Level 1	± 2 kV	± 2 kV	± 4 kV	± 2 kV	± 4 kV	± 6 kV

Component test – Example severity levels for indirect contact discharge (Function performance status)

Test severity level	Direct contact discharge		
	Category 1	Category 2	Category 3
Level 4	± 8 kV	± 15 kV	± 20 kV
Level 3	± 6 kV	± 8 kV	± 15 kV
Level 2	± 4 kV	± 4 kV	± 8 kV
Level 1	± 2 kV	± 2 kV	± 4 kV

Vehicle test — Example severity levels for contact discharge and air discharge (Test points accessible only from inside vehicle)

Test severity level	Contacts discharge			Air discharge		
	Category 1	Category 2	Category 3	Category 1	Category 2	Category 3
Level 4	± 6 kV	± 8 kV	± 8 kV	± 8 kV	± 15 kV	± 15 kV
Level 3	± 4 kV	± 4 kV	± 6 kV	± 6 kV	± 8 kV	± 8 kV
Level 2	± 2 kV	± 2 kV	± 2 kV	± 4 kV	± 4 kV	± 6 kV
Level 1	–	–	–	± 2 kV	± 2 kV	± 4 kV

Vehicle test — Example severity levels for contact discharge and air discharge (Test points accessible only from outside vehicle)

Test severity level	Contacts discharge			Air discharge		
	Category 1	Category 2	Category 3	Category 1	Category 2	Category 3
Level 4	± 6 kV	± 8 kV	± 8 kV	± 15 kV	± 15 kV	± 25 kV
Level 3	± 4 kV	± 6 kV	± 6 kV	± 8 kV	± 8 kV	± 15 kV
Level 2	± 2 kV	± 4 kV	± 4 kV	± 4 kV	± 6 kV	± 8 kV
Level 1	–	–	± 2 kV	± 2 kV	± 4 kV	± 6 kV

3. Specification of generator and verification of output waveform

■ Specification of ESD simulator

Following specification must be satisfied with the simulator for the test.



Parameter	Specification
Output voltage . Contact discharge-(kV)	2 kV ~ 15 kV
Output voltages - Air discharge-(kV)	2 kV ~ 25 kV
Output voltages accuracy (%)	≤ 5%
Polarity	Positive and negative
Rise time of short circuit current in contact discharge mode(10% to 90%)	0.7 ns ~ 1 ns
Holding time	≥ 5 s
Storage capacitances(pF)	150 pF, 330 pF
Discharge resistances(Ω)	2 kΩ, 330 Ω

Testing Summary according to ISO 10605 Ed.2 Standard

Contact discharge mode current specifications

Following discharges characteristics should be verified.


Typical capacitance / resistance values	Peak current / charge voltage	Current at T1 / Charge voltage	Current at T2 / Charge voltage
① 150 pF / 330 Ω	3.75 A / kV ± 10%	2 A / kV ± 30% (t1 = 30 ns)	1 A / kV ± 30 % (t2 = 60 ns)
② 330 pF / 330 Ω		2 A / kV ± 30% (t1 = 65 ns)	1 A / kV ± 30 % (t2 = 130 ns)
③ 150 pF / 2 kΩ	3.75 A / kV ± 30% -0%	0.275 A / kV ± 30% (t1 = 180 ns)	0.15 A / kV ± 50 % (t2 = 360 ns)
④ 330 pF / 2 kΩ		0.275 A / kV ± 30% (t1 = 400 ns)	0.15 A / kV ± 50 % (t2 = 800 ns)

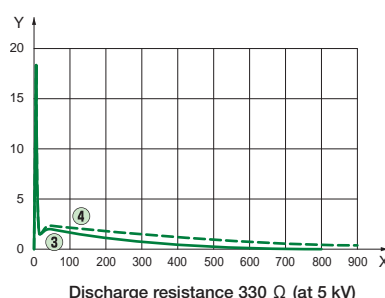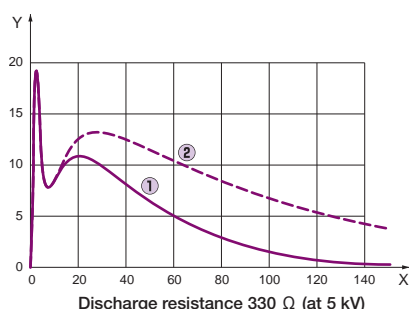


Verification of output current waveform

The waveform shall be verified with an oscilloscope whose bandwidth is 1 GHz or more in a Faraday cage or with a 1.2 m × 1.2 m metallic board mounting an ESD current target in the center of the cage or the board. The discharge electrode (Discharge tip of the gun) shall be touched onto the target and the discharge mode shall be set at the contact discharge mode.

The discharge return cable shall be turned up the center of the length and connected to vertically 0.5 m under the target on surface of the Faraday cage or board.

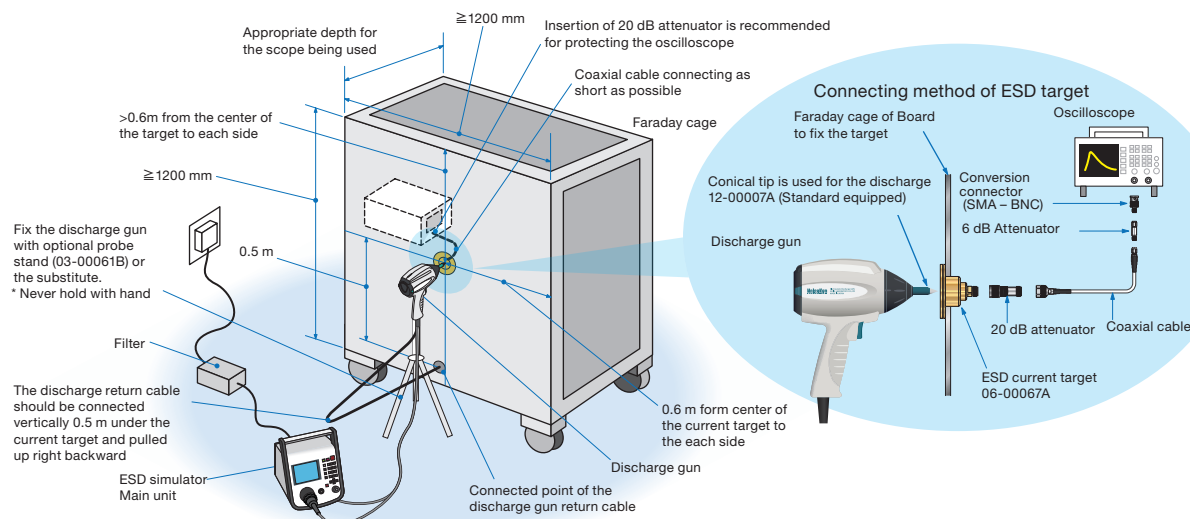


Calibration of target

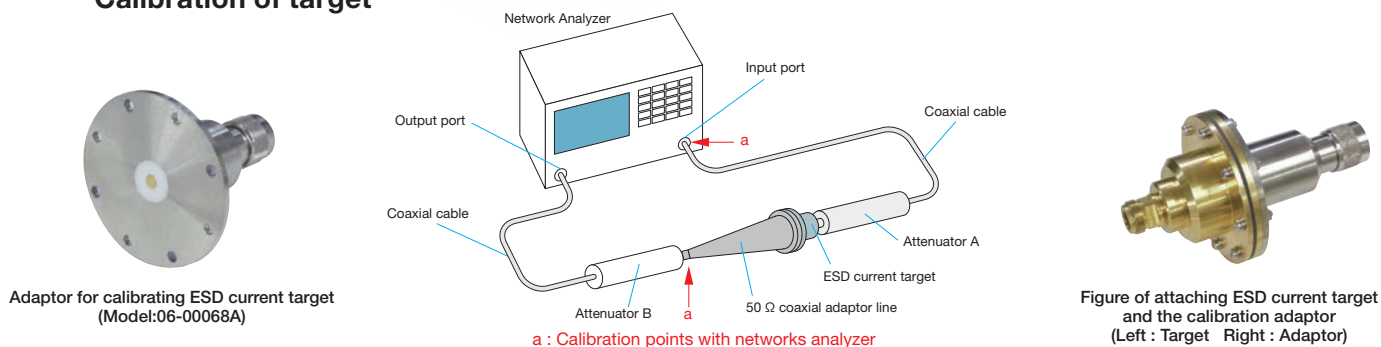

4. Test setup and test procedure


- Capacitance shall be selected to 150 pF (In case for components accessible from outside vehicle) or 330 pF (In case for components accessible from inside vehicle) and resistance shall be 330 Ω .
- The test level shall be two or more.
- At least 3 discharges shall be applied both to the positive and negative polarities with the interval not less than 1s. The time intervals between successive single discharges in the indirect discharge shall be longer than 50 ms and the number of the test shall be > 50 times.
- In the contact discharge, it shall be done to wherever human finger may touch.
- In the air discharge, the speed of approach should be between 0.1 m / s and 0.5 m / s and the discharge tip is held perpendicular to the surface of the DUT when possible; if not possible, an angle of at least 45° to the surface of the DUT is preferred.
- Insulating blocks shall be used for DUT which is not grounded to the chassis directly.

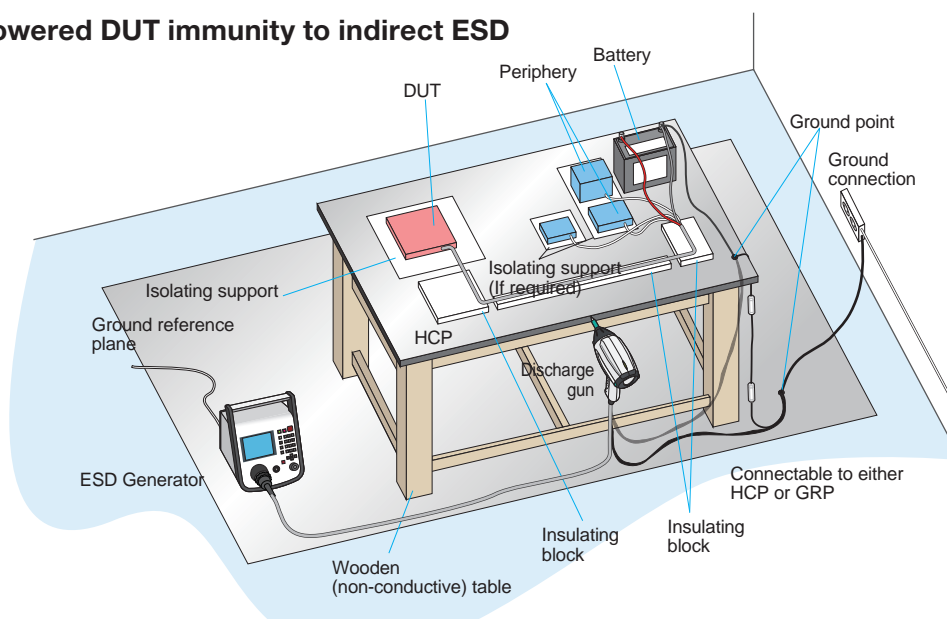

Testing Summary according to ISO 10605 Ed.2 Standard

■ For testing (unpowered) packaging and handling ESD sensitivity

- Capacitance shall be selected to 150 pF (Although the resistance value is not provided, it is recommended to perform the tests supposing both resistance when the DUT may be directly accessible by human body (2 k Ω) and it may be accessible by a metal object a human hold (330 Ω))
- The test level shall be two or more.
- At least 3 discharges shall be applied both to the positive and negative polarities with the interval not less than 1s.
- In the contact discharge, it shall be done to wherever human finger may touch.
- Charge build-up should be eliminated by briefly connecting a bleeder wire with high resistance (> 1 M Ω) after the discharge and the DUT shall be turned on. Afterwards, normal operation of it shall be confirmed.

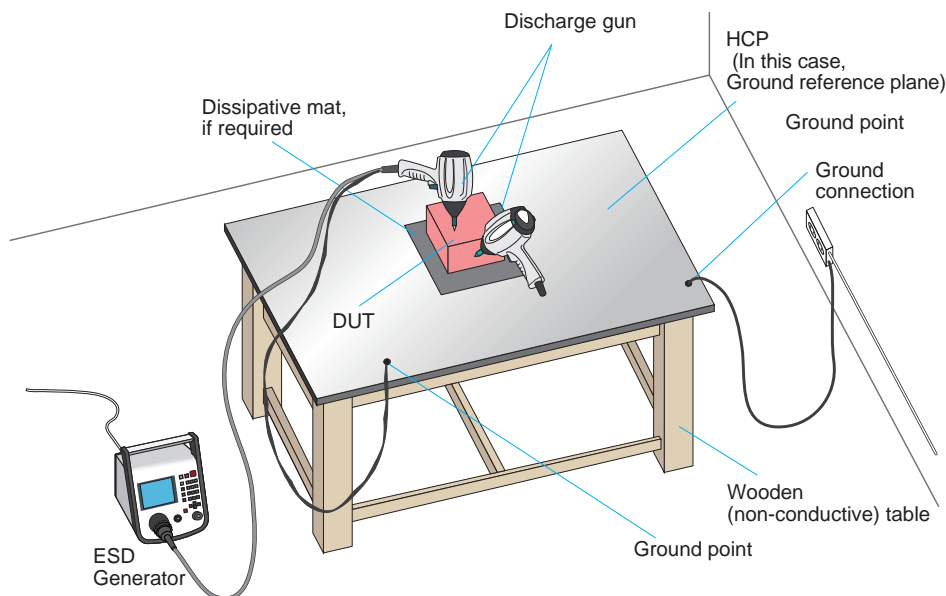


■ Vehicle test – Internal and external points

- Choose a generator capacitance of 330 pF for areas that can easily be accessed only from the inside of the vehicle and resistance of 330 Ω or 2 k Ω
- Choose a capacitance of 150 pF for points that can easily be touched only from the outside of the vehicle and resistance of 330 Ω or 2 k Ω .
- The ESD generator ground shall be connected to chassis like the seat-rail in case of the interior test or connected to a metallic plate under the wheel closest to the application point in case of the exterior test.
- Both the contact discharge and air discharge shall be done both for the internal and external.




Internal test

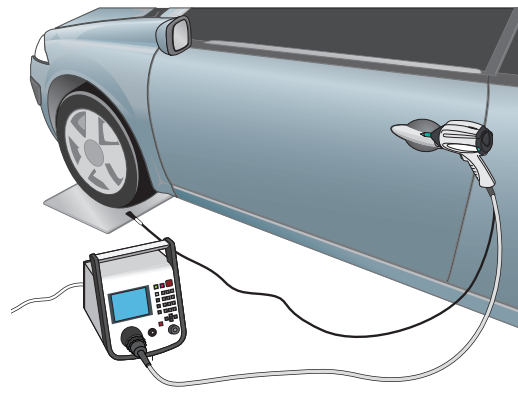

External test

Testing Summary according to ISO 10605 Ed.2 Standard

■ Optional test set-up and procedure for electronic modules (powered-up test) – Direct and indirect discharge

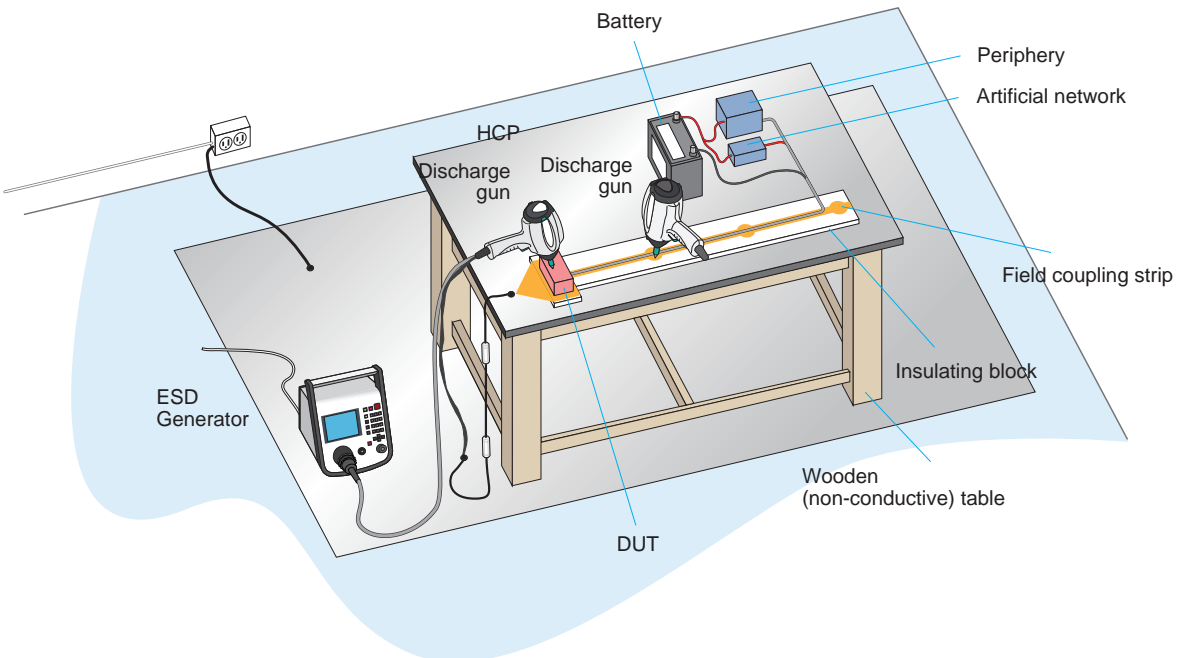

Notes: This test set-up is quoted from ISO10605 ed2.0 (2008) Standard.
Please go through the Standard if the more details are required.